


DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/12/03	A	FOR APPROVAL	CUST	TL	JK

FIELD

OPERATOR'S LABORATORY ENCLOSURE

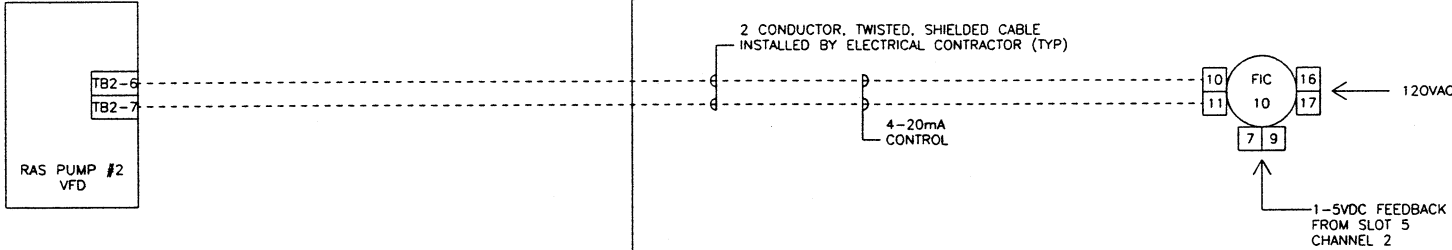

06/04/03 13:03	WIRE LUGS - NO ☒ YES ☐		RING ☐ LOCKING SPADE ☐				TOLERANCES						
	INSULATION: NYLON ☐ PVC ☒						DECIMAL	± 0.3	CITY OF MASSILLON, OHIO REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000 PROJECT NO. E9031	SCALE NONE	DRAWN BY TL		
			WIRE SPECIFICATIONS:							FRACTIONAL	± 1/32"	TITLE RAS PUMP #2 VFD SPEED CONTROL	
			USAGE							ANGULAR	± 1°		
			AC PANEL POWER			AWG #12 BLK.		THW/THHN					
			AC PANEL NEUTRAL			AWG #12 WHT.		THW/THHN					
			AC PANEL GROUND			AWG #12 GRN.		THW/THHN					
			AC CONTROL POWER			AWG #14 RED		THW/THHN					
			AC CONTROL NEUTRAL			AWG #14 WHT.		THW/THHN					
			AC FOREIGN			AWG #14 YELLOW		THW/THHN					
			DC POWER			AWG #16 BLUE		THW/THHN					
			DC CONTROL			AWG #16 BLUE		THW/THHN					
		SIGNAL/INSTRUMENTS		AWG #16 2 CONDUCTOR SHLD		THW/THHN							