


DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/12/03	A	FOR APPROVAL	CUST	TL	JK

FIELD

OPERATOR'S LABORATORY ENCLOSURE

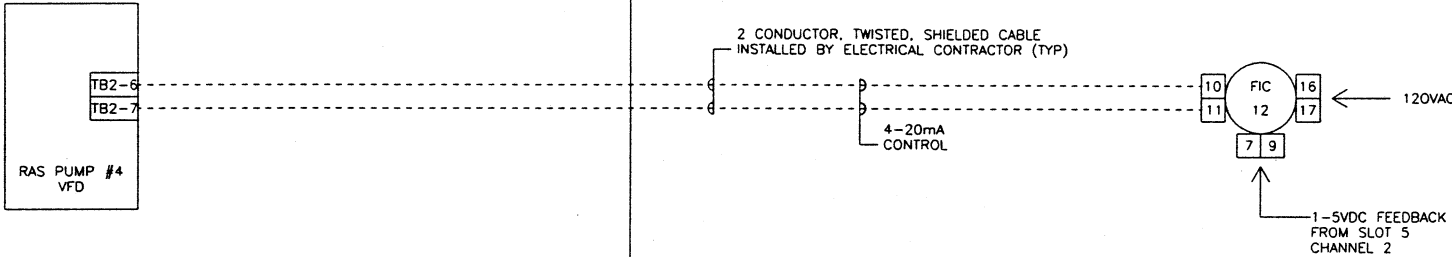

08/28/02 09:07	WIRE LUGS - NO ☒ YES ☐	RING ☐ LOCKING SPADE ☐		 KOKOSING CONSTRUCTION CO. P.O. #1	TOLERANCES	 DUBLIN TECHNICAL SYSTEMS, INC.	
	INSULATION: NYLON ☐ PVC ☒	DECIMAL ± .03			CITY OF MASSILLON, OHIO REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000 PROJECT NO. E9031		SCALE NONE
	WIRE SPECIFICATIONS:				FRACTIONAL ± 1/32"	TITLE RAS PUMP #4 SPEED CONTROL	
	USAGE	SIZE	COLOR	INSULATION	ANGULAR ± 1"	DATE 9/18/02	DRAWING NUMBER DTSI - 02040 - 233
	AC PANEL POWER	AWG #12	BLK.	THW/THHN			
	AC PANEL NEUTRAL	AWG #12	WHT.	THW/THHN			
	AC PANEL GROUND	AWG #12	GRN.	THW/THHN			
	AC CONTROL POWER	AWG #14	RED	THW/THHN			
	AC CONTROL NEUTRAL	AWG #14	WHT.	THW/THHN			
	AC FOREIGN	AWG #14	YELLOW	THW/THHN			
	DC POWER	AWG #16	BLUE	THW/THHN			
	DC CONTROL SIGNAL/INSTRUMENTS	AWG #16	2 CONDUCTOR SHLD	THW/THHN			