


DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/12/03	A	FOR APPROVAL	CUST	TL	JK

L5B FIELD

PLC PANEL NODE 6

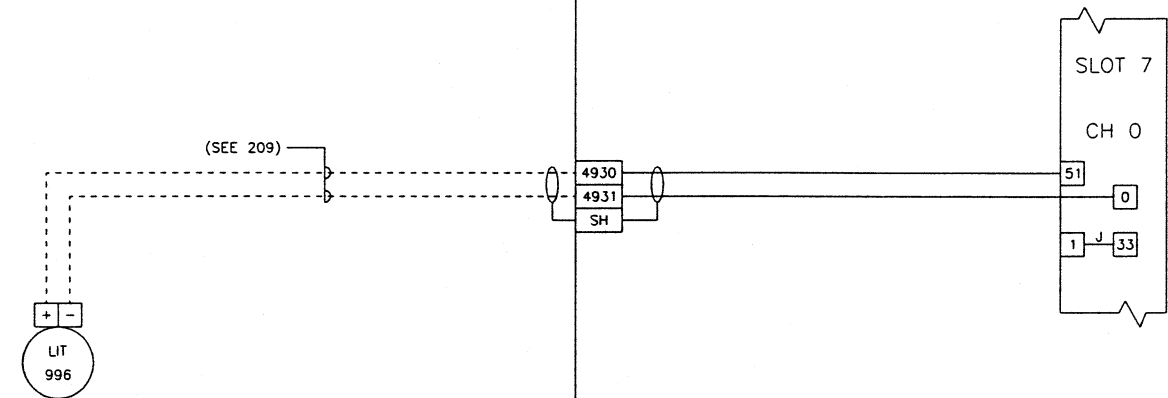

TAG: LIT-996
MANUFACTURER: MILLTRONICS
MODEL: ?
POWER: 120 VAC
ENCLOSURE: NEMA 4X
CALIBRATION RANGE: 0-30 FEET

10/29/02 11:16	WIRE LUGS - NO ☒ YES ☐		RING ☐ LOCKING SPADE ☐			 KOKOSING CONSTRUCTION CO. P.O. #	TOLERANCES		 DUBLIN TECHNICAL SYSTEMS, INC.				
	INSULATION: NYLON ☐ PVC ☒						DECIMAL	± 0.3	CITY OF MASSILLON, OHIO REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000 PROJECT NO. 02040	SCALE NONE	DRAWN BY TL		
	WIRE SPECIFICATIONS:						DUBLIN TECHNICAL SYSTEMS INC. PROJECT # 02040		FRACTIONAL	± 1/32"	TITLE PRIMARY DIGESTER LEVEL		
	USAGE								ANGULAR	± 1'	DATE 9/18/02	DRAWING NUMBER DTSI - 02040 - 262	
	AC PANEL POWER		AWG #12 BLK.			THW/THHN							
	AC PANEL NEUTRAL		AWG #12 WHT.			THW/THHN							
	AC PANEL GROUND		AWG #12 GRN.			THW/THHN							
	AC CONTROL POWER		AWG #14 RED			THW/THHN							
	AC CONTROL NEUTRAL		AWG #14 WHT.			THW/THHN							
	AC FOREIGN		AWG #14 YELLOW			THW/THHN							
	DC POWER		AWG #16 BLUE			THW/THHN							
	DC CONTROL		AWG #16 BLUE			THW/THHN							
	SIGNAL/INSTRUMENTS		AWG #16 2 CONDUCTOR SHLD.			THW/THHN							