

DATE	SYM	REVISION RECORD	AUTH	DR	CK
5/12/03	A	FOR APPROVAL	CUST	TL	JK


L6B FIELD

PLC PANEL NODE 6

DIGESTER LEVEL ALARM PANEL

FIELD

BFP CONTROL PANEL

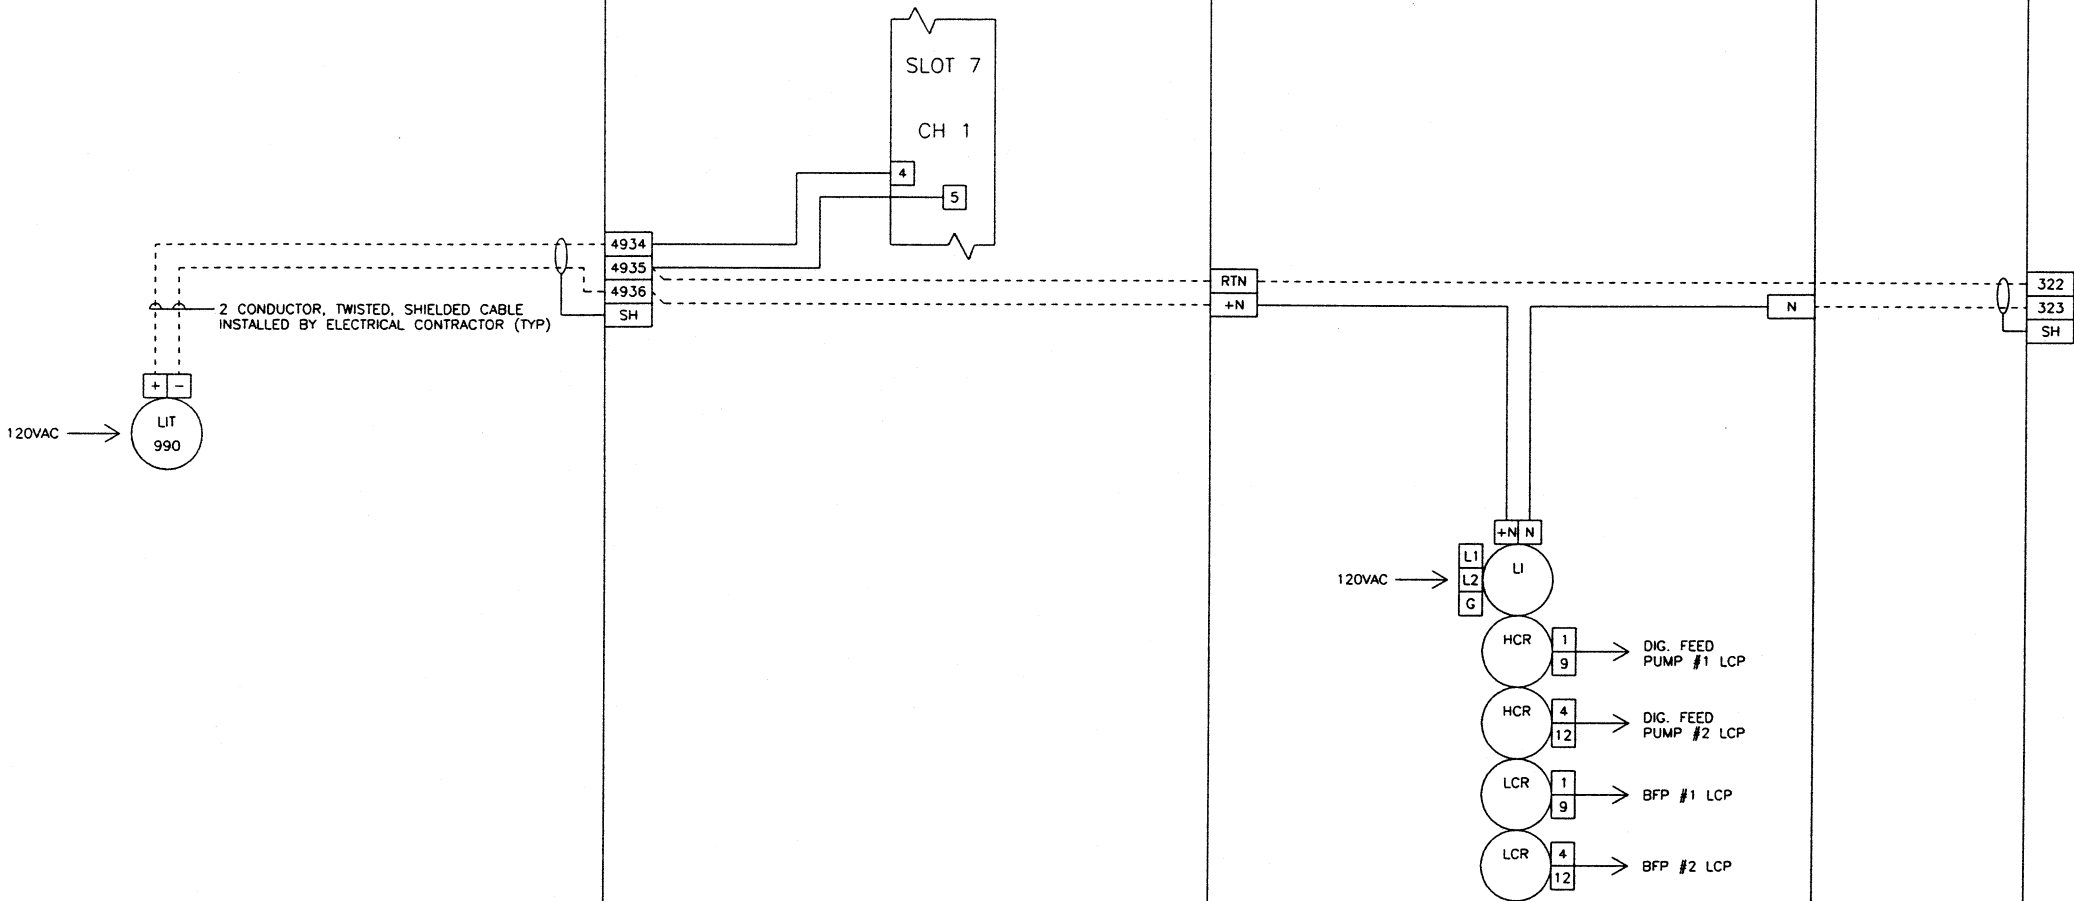

TAG: LIT-990
MANUFACTURER: MILLTRONICS
MODEL: ?
POWER: 120 VAC/60 HZ
ENCLOSURE: ?
CALIBRATION RANGE: 0-30 FEET

06/05/03 11:57

WIRE LUGS - NO ☒ YES ☐

INSULATION: NYLON ☐ PVC ☒

WIRE SPECIFICATIONS:

USAGE	SIZE	COLOR	INSULATION
AC PANEL POWER	AWG #12	BLK.	THW/THHN
AC PANEL NEUTRAL	AWG #12	WHT.	THW/THHN
AC PANEL GROUND	AWG #12	GRN.	THW/THHN
AC CONTROL POWER	AWG #14	RED	THW/THHN
AC CONTROL NEUTRAL	AWG #14	WHT.	THW/THHN
AC FOREIGN	AWG #14	YELLOW	THW/THHN
DC POWER	AWG #16	BLUE	THW/THHN
DC CONTROL SIGNAL/INSTRUMENTS	AWG #16	BLUE	THW/THHN

06/05/03 11:57

WIRE LUGS - NO ☒ YES ☐

INSULATION: NYLON ☐ PVC ☒

WIRE SPECIFICATIONS:

USAGE	SIZE	COLOR	INSULATION
AC PANEL POWER	AWG #12	BLK.	THW/THHN
AC PANEL NEUTRAL	AWG #12	WHT.	THW/THHN
AC PANEL GROUND	AWG #12	GRN.	THW/THHN
AC CONTROL POWER	AWG #14	RED	THW/THHN
AC CONTROL NEUTRAL	AWG #14	WHT.	THW/THHN
AC FOREIGN	AWG #14	YELLOW	THW/THHN
DC POWER	AWG #16	BLUE	THW/THHN
DC CONTROL SIGNAL/INSTRUMENTS	AWG #16	BLUE	THW/THHN

STATE OF OHIO

ROBERT A. LANDTHORN

E-37992

REGISTERED PROFESSIONAL ENGINEER

KOKOSING CONSTRUCTION CO.

P.O. #

DUBLIN TECHNICAL SYSTEMS INC.

PROJECT # 02040

TOLERANCES

+	0.3
-	0.3

DECIMAL

+	0.3
-	0.3

FRACTIONAL

+	1/32"
-	1/32"

ANGULAR

+	1°
-	1°

DUBLIN TECHNICAL SYSTEMS, INC.

CITY OF MASSILLON, OHIO

REGIONAL WASTEWATER TREATMENT PLANT - UPGRADE 2000

PROJECT NO. E9031

SCALE

NONE

DRAWN BY

TL

APPROVED BY

JK

TITLE

SECONDARY DIGESTER LEVEL, L6B

DATE

9/18/02

DRAWING NUMBER

DTSI - 02040 - 263