


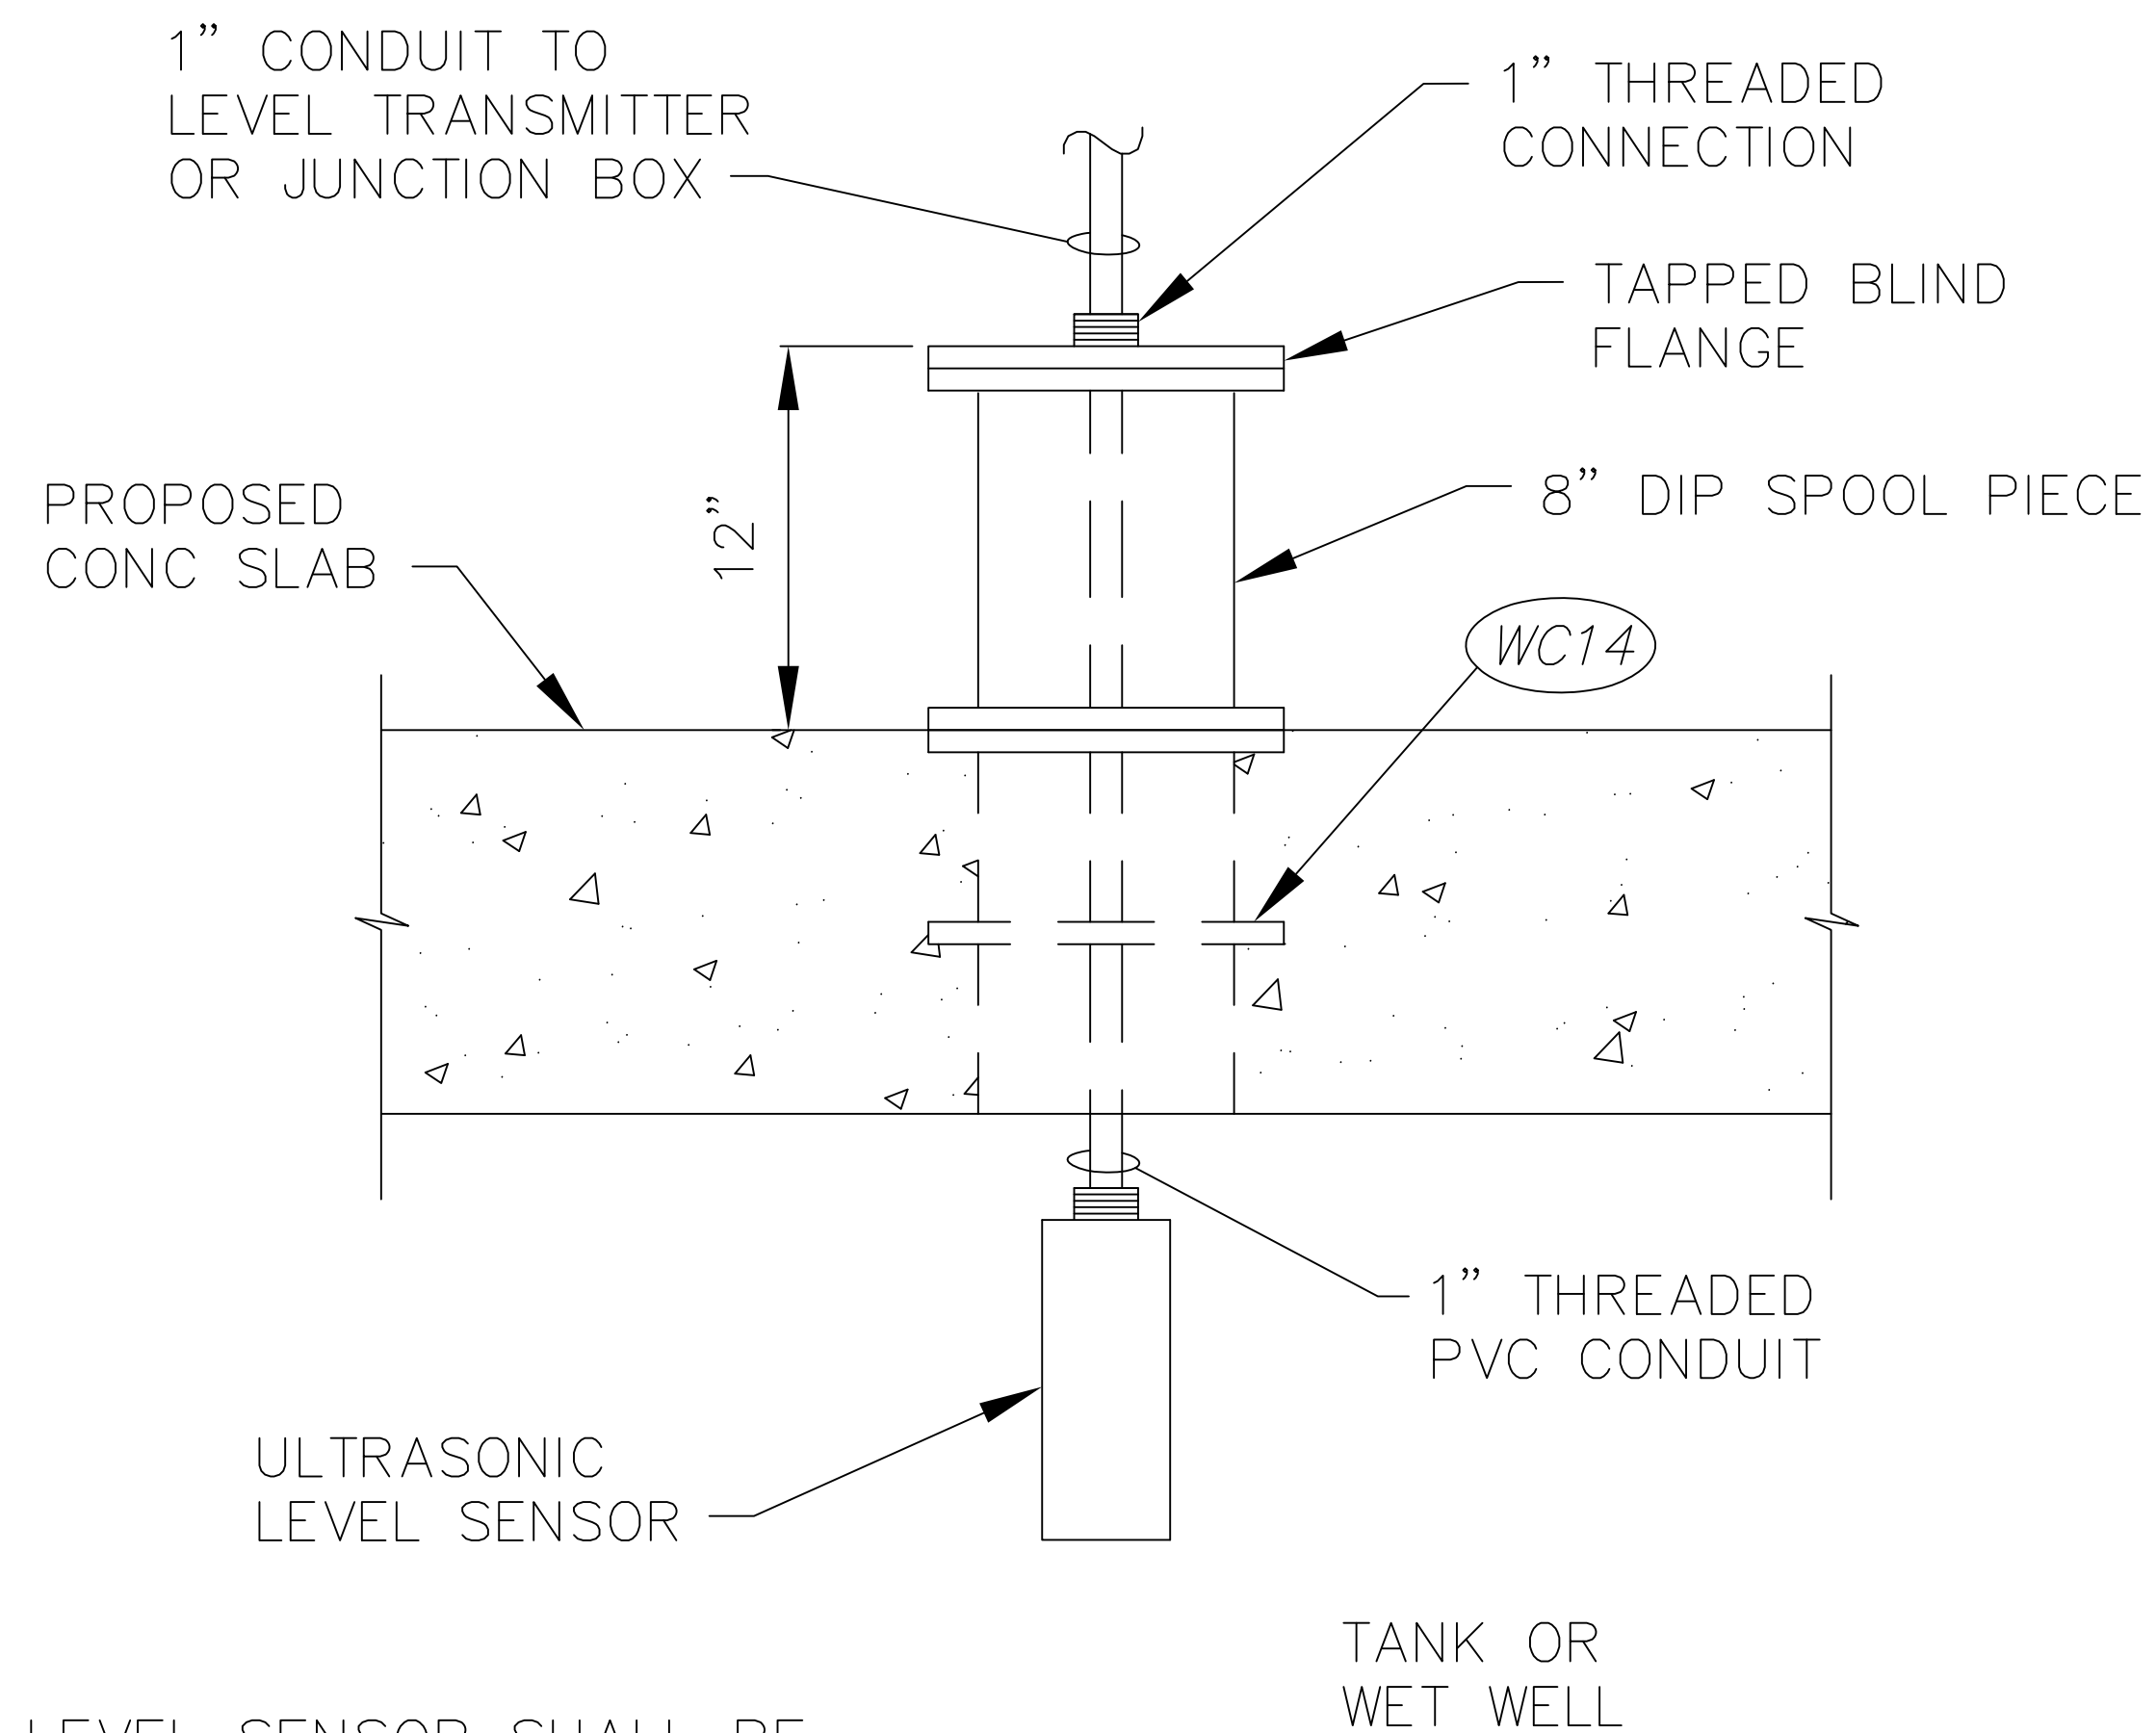

- NOTES:
1. ULTRASONIC LEVEL SENSOR SHALL BE LOCATED 24" MIN FROM ADJACENT WALLS AND EQUIPMENT OR AS OTHERWISE REQUIRED BY MANUFACTURER.
 2. PROVIDE SUFFICIENT LENGTH OF CABLE AND WIRE FOR SENSOR TO BE REMOVED WITHOUT DISCONNECTING CABLES.

*SLAB MOUNTED ULTRASONIC
LEVEL SENSORS*

SCALE: NTS

ADDENDUM NO. 3

CITY OF MASSILLON, OHIO
WWTP UPGRADE 2000



SK-P135-002