



CITY OF MASSILLON, OHIO

151 LINCOLN WAY EAST
MUNICIPAL GOVERNMENT ANNEX
CITY ADMINISTRATION BUILDING
MASSILLON, OHIO 44646
PHONE 330-830-1722 FAX 330-830-1786

PERMIT DATE:

9/1/2011

PERMIT NO.

4151

PERMIT TO TAP SANITARY SEWER

This permit is issued subject to the latest Codified Ordinances of the City of Massillon, OH. The City Engineer to be notified 24 hours in advance of start of work (330) 830-1722. All permits issued under this ordinance are void after 120 days from date of issuance.

RECEIVED OF:

CONTRACTOR INFORMATION

CONTRACTOR: BUCKEYE PLUMBING

CONTACT: MITCH

ADDRESS:

CITY:

STATE:

ZIP:

PHONE: (330) 877-3122

FAX:

SURETY:

PERMIT TYPE

SITE INFORMATION

OWNER'S NAME: ALLIED CORP

FULL STREET ADDRESS: 390 WARMINGTON RD SW

CITY LOT NUMBER OL 1043

PURPOSE OF CUT: SANITARY

ZONING CLASS:

STREET SIDE: North

PHONE OTHER:

SANITARY SEWER CONNECTION:

USE: Industrial

DATE INSPECTED 9/21/2011

located on the SOUTH side of

WARMINGTON RD between

CARMONT and

COMMERCE

Direction from downstream Manhole:

Distance from downstream Manhole: TAPS INT

Connection Length: 88.00 (FEET)

Connection Depth: 11 (FEET)

Size of Sewer Pipe: 6 (INCHES)

Pipe Material: PVC- DIP

INSPECTORS NAME: JEFF KING

COMMENTS: TAPPED INTO MH OUTSIDE DROP

NOTE: This permit covers work outside of the building ONLY. Any work inside walls of the building is subject to the Massillon Board of Health Regulations.

SKETCH: DRAWING #:

See next page

INSPECTION REQUEST:

SANITARY SEWER PERMIT FEE: \$200.00


CAPACITY FEE: \$1,005.00

TOTAL COST: \$1,205.00

TWO WORKING DAYS BEFORE YOU DIG
Ohio Utilities Protection Service
Call 1-800-362-2764 Toll Free....
Non-Members must be called directly.

AUTHORIZED BY: DIRECTOR OF PUBLIC SAFETY AND SERVICE

ISSUED BY: Jeffery King

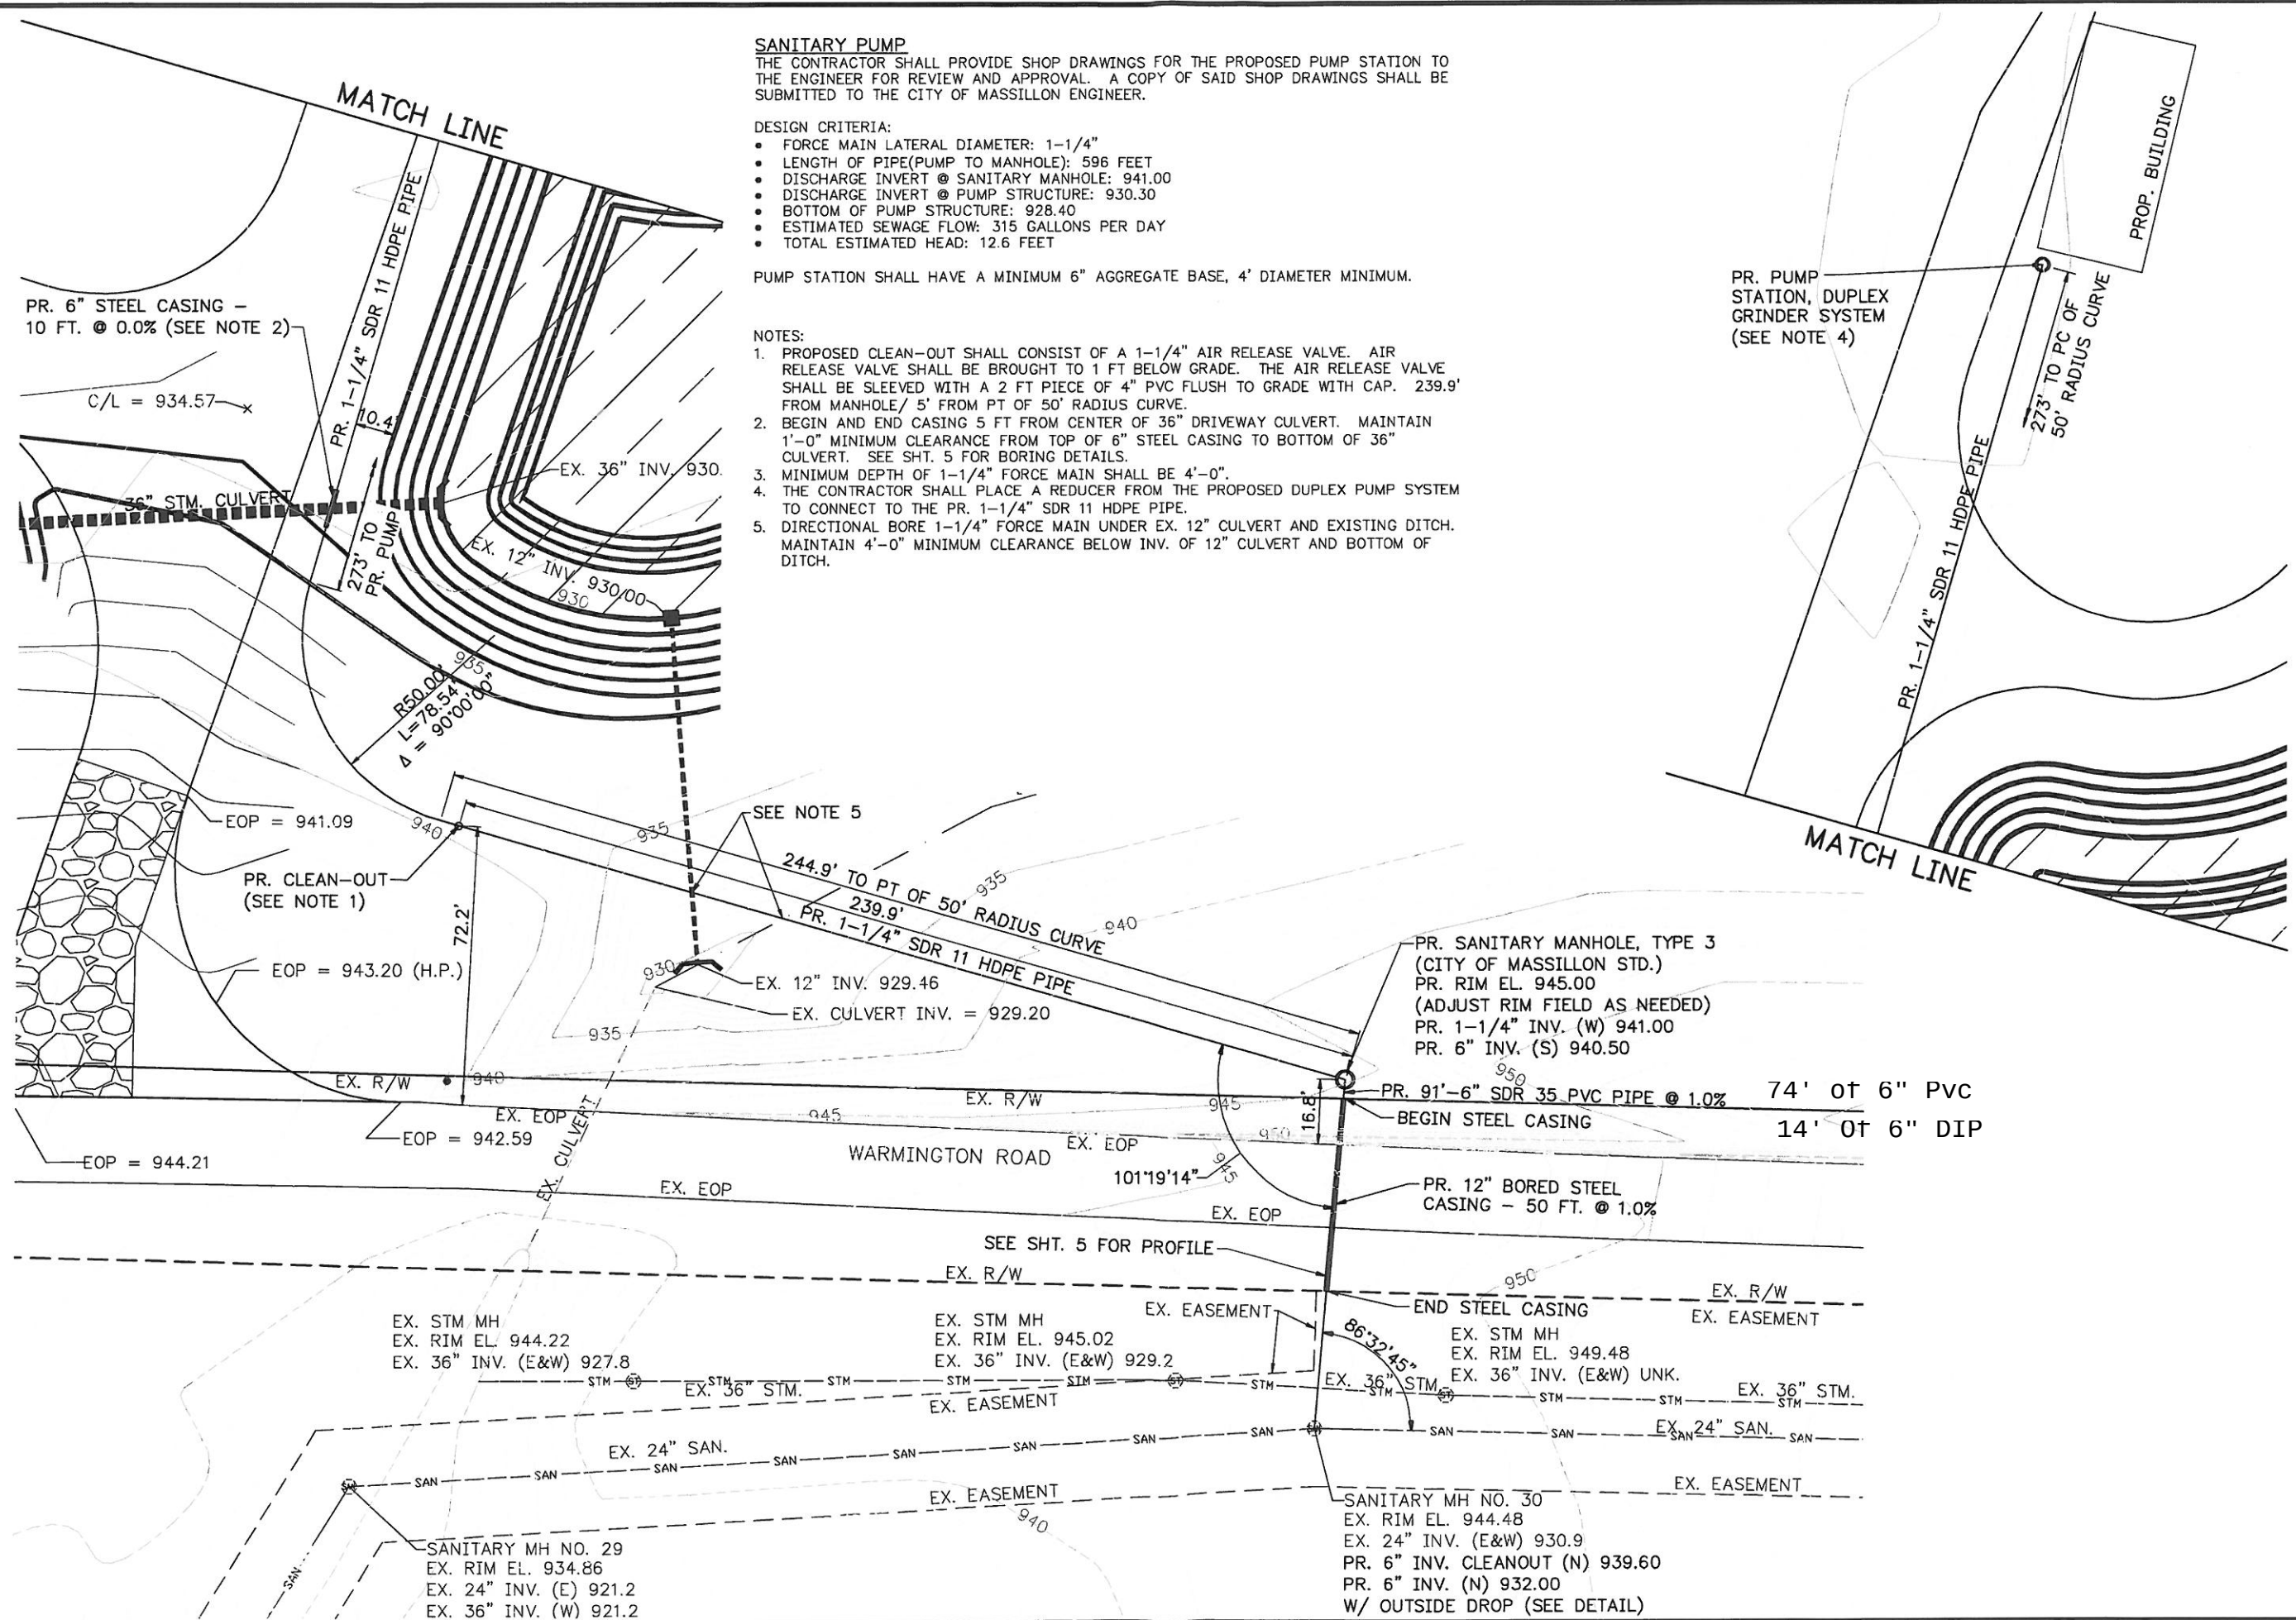

SANITARY PUMP

DESIGN CRITERIA:

PUMP STATION SHALL HAVE A MINIMUM 6" AGGREGATE BASE, 4' DIAMETER MINIMUM.

1. PROPOSED CLEAN-OUT SHALL CONSIST OF A 1-1/4" AIR RELEASE VALVE. AIR RELEASE VALVE SHALL BE BROUGHT TO 1 FT BELOW GRADE. THE AIR RELEASE VALVE SHALL BE SLEEVED WITH A 2 FT PIECE OF 4" PVC FLUSH TO GRADE WITH CAP. 239.9' FROM MANHOLE/ 5' FROM PT OF 50' RADIUS CURVE.
2. BEGIN AND END CASING 5 FT FROM CENTER OF 36" DRIVEWAY CULVERT. MAINTAIN 1'-0" MINIMUM CLEARANCE FROM TOP OF 6" STEEL CASING TO BOTTOM OF 36" CULVERT. SEE SHT. 5 FOR BORING DETAILS.
3. MINIMUM DEPTH OF 1-1/4" FORCE MAIN SHALL BE 4'-0".
4. THE CONTRACTOR SHALL PLACE A REDUCER FROM THE PROPOSED DUPLEX PUMP SYSTEM TO CONNECT TO THE PR. 1-1/4" SDR 11 HDPE PIPE.
5. DIRECTIONAL BORE 1-1/4" FORCE MAIN UNDER EX. 12" CULVERT AND EXISTING DITCH. MAINTAIN 4'-0" MINIMUM CLEARANCE BELOW INV. OF 12" CULVERT AND BOTTOM OF DITCH.